



SHORELINE AND WATERWAY MANAGEMENT SECTION Coastal Construction Application

Public Notice No. WSS20250211 Date: 06/22/2025

Application Submitted: **06/12/2025**

To construct a 3rd story addition and deck within the footprint of the existing dwelling
on Lot(s) 15, Block(s) 50, Rehoboth By the Sea, in Sussex County, Delaware

Tax Map # **334-20.10-32.00**

Applicant Information

Name: Amanda Tesoro

Property Type: Residential: Multiple-Family

Activities:

- New construction
 - Additions within existing footprint : Seaward

Flood Zone Information:

In which NFIP Flood Zone(s) is the property located?

AE - Area of 100-year flooding where wave action could reach between 1 and 3 feet, X - Area of 500-year flooding

In which NFIP Flood Zone(s) is the proposed construction taking place?

AE - Area of 100-year flooding where wave action could reach between 1 and 3 feet

What is the Base Flood Elevation (NAVD88)?

9

What is the effective/revised date of the FIRM panel used for flood zone determination?

06/20/2018

Will any enclosures, such as entrances, storage areas, elevators, showers, skirting, utilities etc., be constructed below the first living floor?

Will any concrete, brick or asphalt be used? This could be for flooring, driveways, sidewalks, patios etc.

No

Where will the concrete, brick or asphalt be used?

Dune Preservation Information:

What mitigating measures will be taken to prevent disturbance and damage to the dune during construction?

Sand/silt Fence marking the location of the Building Line, Keeping all equipment personnel and supplies off the dune

Other measure(s) description:

Wetlands:

Will any work be occurring on regulated wetlands located on this lot?

No

Septic:


Is there a septic system on the lot?

No

What is the Septic Permit # of the system (optional)?

Structural survey plan document

ATLANTIC OCEAN

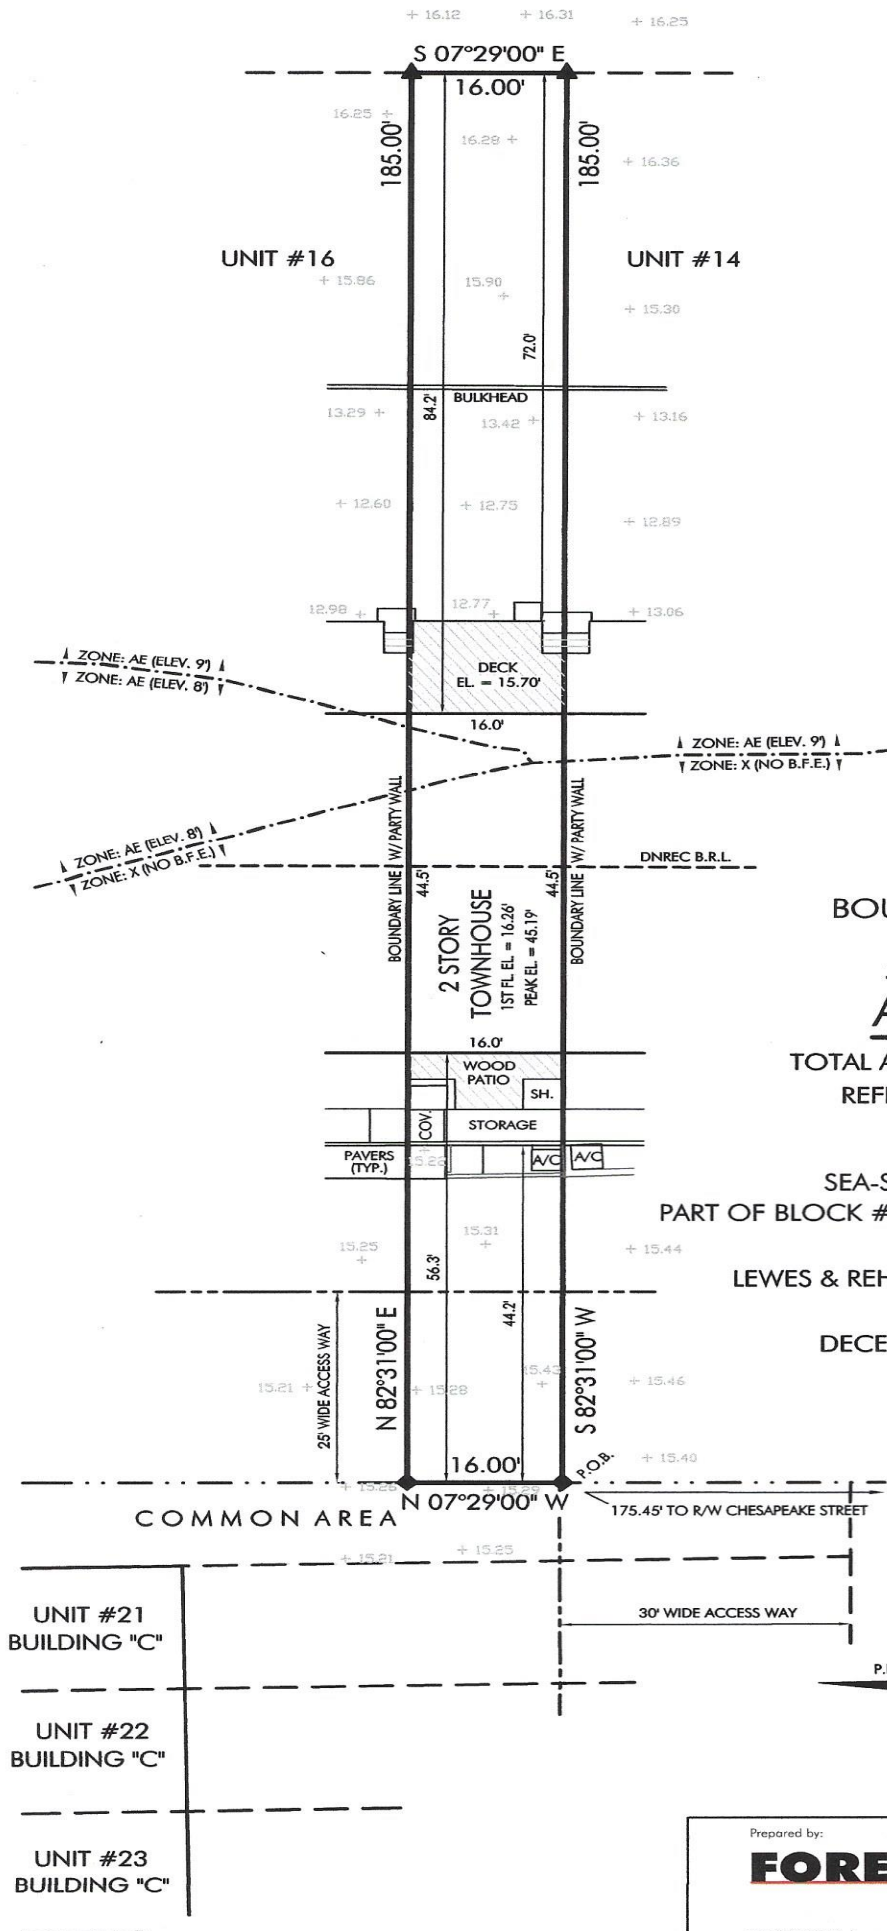

NOTES:

ALL SETBACKS MUST BE VERIFIED BY THE OWNER,
GENERAL CONTRACTOR AND/OR THE DESIGNER.
PLEASE CONTACT THE TOWN OF DEWEY BEACH.
VERTICAL DATUM: NAVD (1988)

THIS PARCEL IS IN FLOOD ZONES:
AE (ELEV. 9'), AE (ELEV. 8') & X (NO B.F.E.)
F.I.R.M. 10005C0354K JUNE 20, 2018

THIS DRAWING DOES NOT VERIFY THE EXISTENCE
OR NON-EXISTENCE OF WETLANDS, UTILITIES,
RIGHT-OF-WAYS OR EASEMENTS IN REFERENCE TO
OR LOCATED ON THIS PROPERTY.

NO TITLE SEARCH PROVIDED OR STIPULATED.
SURVEY CLASS: SUBURBAN

LEGEND:

- | | |
|--------|-------------------------------|
| ▲ | IRON ROD (SET) |
| ◆ | "60D" NAIL (SET) |
| ± 0.00 | ELEVATION SPOT SHOT (NAVD 88) |

TOPOGRAPHIC &
BOUNDARY SURVEY PLAN FOR
ANNA PAGI &
AMANDA NEAL

TOTAL AREA: 2,960 SQ. FT., 0.0680 ACRES

REFERENCE: PLAT BOOK 8 PAGE 6
DEED BOOK 4790 PAGE 46

15 SEASTRAND COURT

SEA-STRAND UNIT #15, BUILDING "B"

PART OF BLOCK #50 OF "REHOBOTH BY THE SEA" SUBDIVISION

TOWN OF DEWEY BEACH

LEWES & REHOBOTH HUNDRED SUSSEX COUNTY

STATE OF DELAWARE

DECEMBER 9, 2024 SCALE: 1" = 20'



P.B. 8-6

Prepared by:

FORESIGHTServices

Surveying & Precision Measurement

302 226 2229 phone

302 226 2239 fax

2103A Coastal Highway

Dewey Beach, DE 19971

Deed/Lease/Sales contract



Real Estate

Owner Information

Customer ID	161060
Name	PAGI ANNA
Name 2	AMANDA NEAL
Address	15 SEASTRAND CT
City State Zip	DEWEY BEACH, DE 19971




Real Estate Property Detail

Parcel ID	334-20.10-32.00-2423
Alternate Parcel ID	334201000320002423
Location	SEASTRAND
Legal Description	SEASTRAND UNIT 15 BLDG B IMP ON LSD LD RBTS
Owner as of July 1	PAGI ANNA
Customer ID	161060
Jurisdiction	CAPE HEN
Deed Recorded	10/27/2017
Book/Page	4790/46
Assessed Value	\$13,150.00
Exemptions Value	\$0.00
2024 Charges	\$648.15


Structure profile view document

PAGI / NEAL RESIDENCE ADDITION


15 SEASTRAND COURT,
DEWEY BEACH, DE 19971

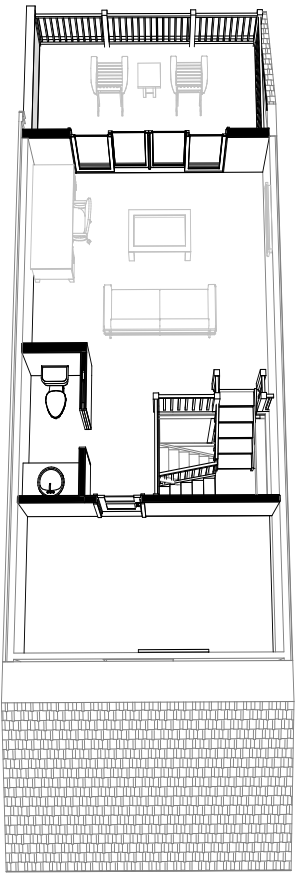

2 FLOOR 3

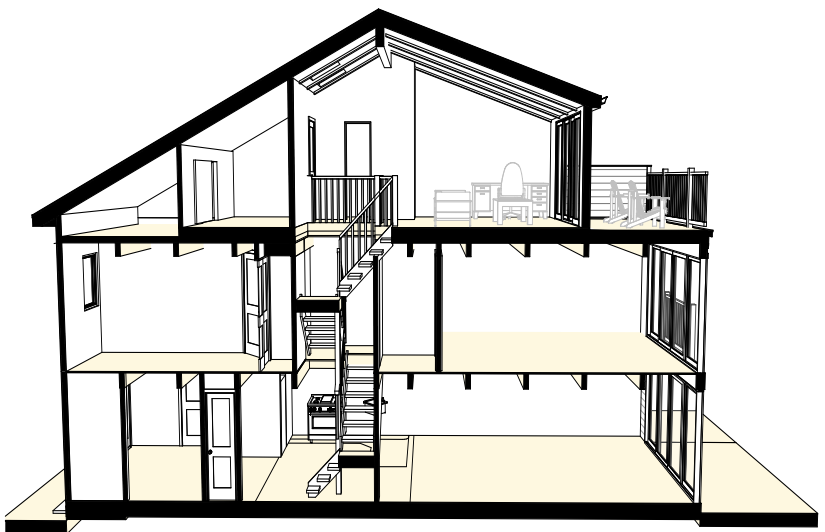

1 SECTION

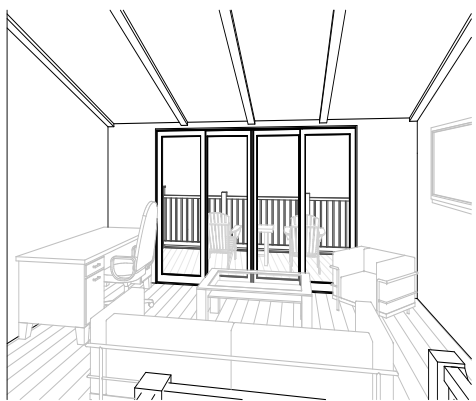

3 LOFT VIEW

BUILDING CODE ANALYSIS DATA	
SITE ADDRESS	15 SEASTRAND COURT, DEWEY BEACH, DE-19971 TAX PARCEL # 334-20-10-32.00
CODE OFFICIAL CONTACTS:	TOWN OF DEWEY BEACH & SUSSEX COUNTY, DE
APPLICABLE CODES:	IRC 2021/ ECG 2010
CONSTRUCTION TYPE:	V-B (SINGLE FAMILY HOME)
ZONING:	NR- NEIGHBORHOOD RESIDENTIAL
LOT SIZE:	2760 SQ. FT.
BUILDING HEIGHT	MAXIMUM ALLOWABLE: 35'-0" FROM GRADE PROPOSED CONSTRUCTION: 24'-4" FROM GRADE
FLOOR AREAS:	SEE AREA PLANS ON A001

SHEET LIST	
NO.	NAME
A001	COVERSHEET
A002	AREA PLANS, NOTES, & SYMBOLS
A101	DEMO PLANS
A201	FLOOR PLANS
A301	SECTIONS & ELEVATIONS
S201	STRUCTURAL NOTES
S201	FRAMING PLANS
S202	FRAMING PLANS

COVERSHEET

REVISIONS		BY
REV.	DATE	DESCRIPTION

PAGI / NEAL RESIDENCE ADDITION
15 SEASTRAND COURT,
DEWEY BEACH, DE 19971
TAX PARCEL # 334-20-10-32.00

ELEMENT
115 W. MARKET STREET, 2nd floor
Dewey, DE 19958
302.645.0777
www.elementry.com

D&N	DRN	CHKD
DDN	DDN	BB
SCALE:		12" = 1'-0"
JOB NO.		624217
ISSUE DATE:		04.09.25
A001		

CONSTRUCTION NOTES:

GENERAL:

- ALL INTERIOR PARTITIONS TO RECEIVE ACOUSTICAL BATT SOUND INSULATION.
- WINDOW SIZES BASED ON VININGCO UNITS.
- BEDROOMS SHALL HAVE AT LEAST ONE WINDOW THAT MEETS EMERGENCY ESCAPE AND RESCUE OPENINGS IN ACCORDANCE WITH R310 OF THE 2021 IRC.

STAIR HANDRAILS:

- HANDRAILS SHALL PROVIDED ON AT LEAST ONE SIDE OF EACH CONTINUOUS RUN OF TREADS OR FLIGHT WITH FOUR OR MORE RISERS.
- HANDRAILS SHALL BE MOUNTED TO A MINIMUM OF 34" HEIGHT, MEASURED VERTICALLY TO THE SLOPED PLANE ADJOINING THE TREAD NOSING OF THE STAIR, AND A MAXIMUM OF 38".
- HANDRAILS SHALL BE CONTINUOUS FOR THE FULL LENGTH OF THE FLIGHT OF STAIRS.
- HANDRAILS ADJACENT TO A WALL SHALL HAVE A SPACE OF NO LESS THAN 1-1/2 INCHES BETWEEN THE WALL AND HANDRAIL.

GUARDS:

- LOCATE GUARDS ALONG ALL WALKING SURFACES, INCLUDING STAIRS, RAMPS, AND LANDINGS, THAT ARE LOCATED MORE THAN 30" ABOVE THE ADJACENT GRADE OR FLOOR BELOW.
- GUARDS SHALL BE MINIMUM OF 36" IN HEIGHT, MEASURED VERTICALLY ABOVE THE ADJACENT WALKING SURFACE.
- GUARDS SHALL NOT HAVE OPENINGS FROM THE WALKING SURFACE TO THE REQUIRED GUARD RAIL HEIGHT THAT ALLOW PASSAGE OF A 4" DIAMETER SPHERE.

WINDOW GUARDS:

- OPERABLE WINDOWS WHERE THE OPENING OF THE WINDOW IS LOCATED MORE THAN 12" ABOVE THE FINISHED GRADE OR SURFACE BELOW, AND THE WINDOW SILL IS LOCATED LESS THAN 24" ABOVE THE FINISH FLOOR, SHALL BE PROVIDED WITH A WINDOW OPENING CONTROL DEVICE, IN ACCORDANCE WITH IRC 2021.

FIRE PROTECTION:

- ENCLOSED ACCESSIBLE SPACES UNDER STAIRS SHALL HAVE WALLS, UNDER-STAIR SURFACE, AND ANY SOFFITS PROTECTED ON THE ENCLOSED SIDE WITH 1/2" GYPSUM BOARD.
- FIRE SEPARATIONS FROM THE RESIDENCE AND ATTICS TO THE GARAGE SHALL HAVE MIN. 1/2" GYPSUM BOARD.
- SEPARATIONS FROM ALL HABITABLE ROOMS ABOVE THE GARAGE SHALL HAVE MIN. 5/8" TYPE X GYPSUM BOARD.
- STRUCTURES SUPPORTING FLOOR/CEILING ASSEMBLIES USED FOR SEPARATION REQUIREMENTS SHALL HAVE MIN. 1/2" GYPSUM BOARD.
- GARAGES LOCATED LESS THAN 3 FEET FROM A DWELLING UNIT ON THE SAME LOT SHALL HAVE MIN. 1/2" GYPSUM BOARD OR EQUIVALENT APPLIED TO THE INTERIOR SIDE OF EXTERIOR WALLS THAT ARE WITHIN THIS AREA.

FIREBLOCKING:

PROVIDE FIREBLOCKING IN WOOD-FRAME CONSTRUCTION IN THE FOLLOWING LOCATIONS:

- IN CONCEALED SPACES OF STUD WALLS AND PARTITIONS, INCLUDING PURSED SPACES AND PARALLEL ROWS OF STUDS OR STAGGERED STUDS, AS FOLLOWS:
 - VERTICALLY AT THE CEILING AND FLOOR LEVELS.
 - HORIZONTALLY AT INTERVALS NOT EXCEEDING 10 FEET.
- AT ALL INTERCONNECTIONS BETWEEN CONCEALED VERTICAL AND HORIZONTAL SPACES SUCH AS OCCUR AT SOFFITS, DROP CEILINGS, AND COVE CEILINGS.
- IN CONCEALED SPACES BETWEEN STAIR STRINGERS AT THE TOP AND BOTTOM OF THE RUN.
- AT OPENINGS AROUND VENTS, PIPES, DUCTS, CABLES AND WIRES AT CEILING AND FLOOR LEVEL, WITH AN APPROVED MATERIAL TO RESIST THE FREE PASSAGE OF FLAME AND PRODUCTS OF COMBUSTION.

FIREBLOCKING MATERIALS CAN INCLUDE:

- TWO INCH NOMINAL LUMBER.
- TWO THICKNESSES OF 1-INCH NOMINAL LUMBER WITH BROKEN LAP JOINTS.
- ONE THICKNESS OF 23/32-INCH WOOD STRUCTURAL PANELS WITH JOINTS BACKED BY 23/32-INCH WOOD STRUCTURAL PANELS.
- ONE THICKNESS OF 3/4-INCH PARTICLEBOARD WITH JOINTS BACKED BY 3/4-INCH PARTICLEBOARD.
- ONE-HALF INCH GYPSUM BOARD.
- ONE-QUARTER INCH CEMENT-BASED MILLBOARD.
- BATTS OR BLANKETS OF MINERAL WOOL OR GLASS FIBER OR OTHER APPROVED MATERIALS INSTALLED IN SUCH A MANNER AS TO BE SECURELY RETAINED IN PLACE.
- CELLULOSE INSULATION INSTALLED AS TESTED FOR THE SPECIFIC APPLICATION.

GENERAL NOTES

- THIS STRUCTURE SHALL BE BUILT IN ACCORDANCE WITH ALL APPLICABLE CODES SET FORTH BY THE AUTHORITY HAVING JURISDICTION. THIS PROJECT WAS DESIGNED IN ACCORDANCE WITH IRC 2021.
- THE CONTRACTOR SHALL BE SOLELY RESPONSIBLE FOR CONSTRUCTION MEANS, METHODS, TECHNIQUES, SEQUENCES, AND PROCEDURES REQUIRED FOR SAFE EXECUTION AND COMPLETION OF WORK, AND FOR INITIATING, MAINTAINING AND SUPERVISING ALL SAFETY PRECAUTIONS AND PROGRAMS IN CONNECTION WITH THE WORK.
- ONLY MOST RECENT SIGNED & SEALED PLANS SHALL BE USED FOR BIDDING CONSTRUCTION PURPOSES; IF IN DOUBT OF MOST RECENT PLAN SET, CONTACT ELEMENT DESIGN GROUP.
- ANY ERRORS, OMISSIONS OR INCONSISTENCIES ON THESE DRAWINGS OR ANY VARIATIONS OR AMBIGUITIES BETWEEN THESE DRAWINGS AND ACTUAL SITE AND CONSTRUCTION CONDITIONS AND/OR REQUIREMENTS SHALL BE BROUGHT TO THE ATTENTION OF THE ARCHITECT IMMEDIATELY.
- THE CONTRACTOR SHALL REVIEW AND BECOME FAMILIAR WITH ALL CONTRACT DOCUMENTS IN THEIR ENTIRETY, SURVEY THE PROJECT AND BECOME FAMILIAR WITH THE EXISTING CONDITIONS AND SCOPE OF WORK. ANY DISCREPANCY AND/OR UNCERTAINTY AS TO WHAT MATERIAL OR PRODUCT IS TO BE USED SHOULD BE VERIFIED WITH THE OWNER AND ARCHITECT.
- THERE SHALL BE NO DEVIATION FROM CONSTRUCTION DOCUMENTS WITHOUT THE WRITTEN APPROVAL OF THE OWNER AND ARCHITECT.
- THE CONTRACTOR SHALL KEEP THE CONSTRUCTION SITE CLEAN AND FREE OF DEBRIS DURING CONSTRUCTION. THIS INCLUDES, BUT IS NOT LIMITED TO ALL GLAZING (BOTH SIDES) AND ALL HORIZONTAL AND VERTICAL SURFACES.
- PROVIDE ALL O & M MANUALS FOR ALL INSTALLED EQUIPMENT, FIXTURES, AND SYSTEMS TO OWNER.

PERMITTING AND APPROVALS


- THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING ALL REQUIRED BUILDING PERMITS, LICENSES, AND INSPECTIONS.
- THE CONTRACTOR SHALL BE RESPONSIBLE FOR COORDINATION WITH THE OWNER'S REVIEW REQUIREMENTS AND SPECIFICATIONS. CONTRACTOR SHALL MEET WITH THE OWNER PRIOR TO START OF CONSTRUCTION ACTIVITIES.

EXISTING CONDITIONS GENERAL NOTES:


- THE CONTRACTOR SHALL VERIFY DIMENSIONS OF AS-BUILT CONDITIONS, AND NOTIFY THE ARCHITECT IN WRITING OF ANY DISCREPANCIES. ALL INFORMATION SHOWN ON THE CONSTRUCTION DOCUMENTS IS BASED ON FIELD OBSERVATIONS AND/OR THE ORIGINAL CONSTRUCTION DOCUMENTS OF THE FACILITY.
- THE CONTRACTOR SHALL VERIFY ALL EXISTING CONDITIONS AS THEY RELATE TO THE NEW WORK. THIS INCLUDES, BUT IS NOT LIMITED TO, FLOOR TO FLOOR HEIGHTS, WINDOW LOCATIONS, WINDOW OPENINGS, AND ROOF PITCHES.
- THE CONTRACTOR SHALL PROVIDE PROTECTIVE COVERINGS FOR CARPET, FURNISHINGS, AND FINISHES IN EXISTING AREAS NOT DESIGNATED FOR DEMOLITION OR NEW CONSTRUCTION. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE REPAIR OF ANY DAMAGE CAUSED BY HIS WORK OR ANY SUBCONTRACTOR.
- THE FINISH FACE OF MATERIAL OF NEW PARTITIONS SHALL ALIGN ON BOTH SIDES OF THE PARTITION WITH THE FACE OF THE MATERIALS ON EXISTING COLUMNS, WALLS, OR PARTITIONS, UNLESS NOTED OTHERWISE.
- THE CONTRACTOR SHALL BE RESPONSIBLE FOR CORRECTING DEFECTIVE WORK IN EXISTING CONSTRUCTION WITHIN THE LIMITS OF THE CONSTRUCTION AREA. THIS INCLUDES, BUT IS NOT LIMITED TO, UNEVEN SURFACES AND FINISHES AT PLASTER OR GYPSUM BOARD. THE CONTRACTOR SHALL PATCH AND REPAIR SURFACES TO MATCH NEW ADJACENT SURFACES.
- COORDINATE PLANS FOR NEW CONSTRUCTION AND DEMOLITION PLANS FOR EXTENT OF REMOVAL. REMOVE ONLY THOSE PORTIONS OF WALLS, FLOORS, CEILINGS, ETC., NECESSARY TO ACCOMMODATE NEW CONSTRUCTION.

DEMOLITION NOTES:

- ALL DASHED LINES INDICATE ITEMS TO BE REMOVED.
- GC TO EXECUTE ALL DEMOLITION WORK.
- GC TO EXECUTE ALL CUT AND REPAIR WORK OF EXISTING CONSTRUCTION.
- LIMIT SELECT DEMOLITION TO SMALLEST AREA POSSIBLE TO ACCOMMODATE NEW WORK IN ORDER TO ELIMINATE EXCESSIVE PATCHING AND DAMAGE TO EXIST. FINISHES TO REMAIN.
- ALL PRIME CONTRACTORS AND SUBCONTRACTORS ARE RESPONSIBLE TO COORDINATE WORK TO MINIMIZE SELECT DEMOLITION. GC TO EXECUTE ALL CUT AND REPAIR.
- PROVIDE TEMPORARY BRACING AND SHORING FOR ANY UNSECURED SECTIONS OF WALL CONSTRUCTION, FLOOR AND WALL FRAMING FOR SELECT DEMOLITION.
- NOTIFY ARCHITECT IF FIELD CONDITIONS CONFLICT WITH THE DESIGN INTENT OF CONSTRUCTION DOCUMENTS.
- ALL PRIME CONTRACTORS AND SUBCONTRACTORS ARE RESPONSIBLE FOR PROPER TERMINATION OF EXISTING UTILITIES AS REQUIRED BY THE PROPOSED CONSTRUCTION.
- GC TO PROVIDE PROTECTION OF EXISTING ELEMENTS THAT ARE TO REMAIN.

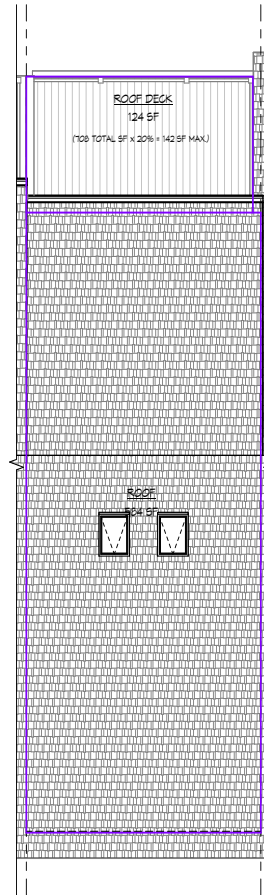

2 ROOF AREA PLAN
1/4" = 1'-0"

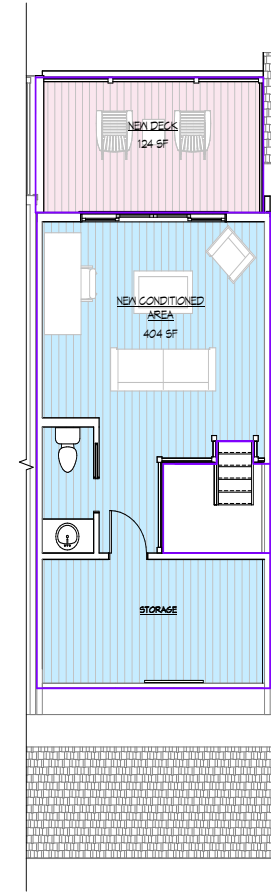

1 NEW THIRD FLOOR AREA PLAN
1/4" = 1'-0"

SYMBOLS

	SECTION CUT - INDICATES SECTION OR DETAIL NUMBER/SHEET NUMBER
	LOCATION: X-X' X-Y' A.F.F.
	ELEVATION HEIGHT MARKER - INDICATES HEIGHT ABOVE FINISH FLOOR & OBJECT
	DRAWING BREAK LINE
	CENTERLINE
	ROOM NAME
	ROOM LABEL
	NORTH ARROW
	WINDOW TAG
	COMBINED CARBON MONOXIDE & SMOKE DETECTOR
	DOOR CALL OUT: (NO. OF UNITS) X-X' X-Y' (SIZE) ABR (TYPE) (NO. OF UNITS) X-X' X-Y' (SIZE) ABR (TYPE) EX. 5000 PR + 3'-0" WIDE X 6'-0" TALL FRENCH DOOR FR: FRENCH DOOR PKCT: POGGET DOOR SLDR: SLIDING DOOR

REV.	DATE	DESCRIPTION

PAGI / NEAL RESIDENCE ADDITION

15 SEASTRAND COURT.
DENVER BEACH, DE 19971


TAX PARCEL # 334-20.10-32.00

ELEMENT
115 W. MARKET STREET, 2nd floor
DENVER, CO 80202
303.645.0777
www.elementally.com


DSN	DRN	CHKD
DDN	DDN	BB
SCALE:	As indicated	
JOB No.	624217	
ISSUE DATE:	04.09.25	

AREA PLANS, NOTES, & SYMBOLS.


A002

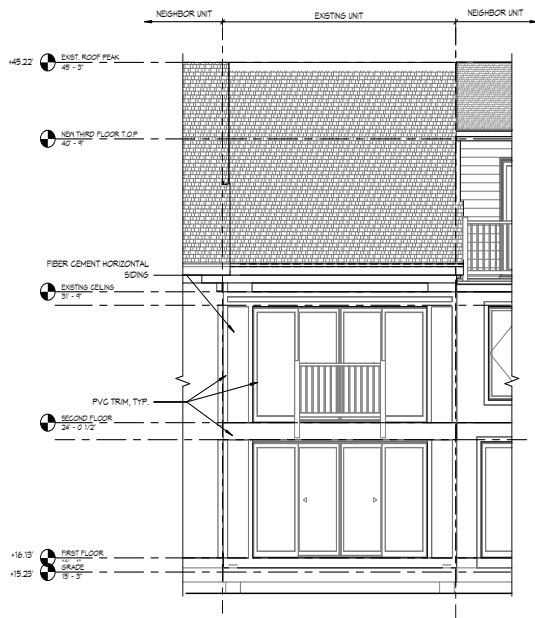


④ REAR ELEVATION (EXISTING/DEMO)
1/4" = 1'-0"

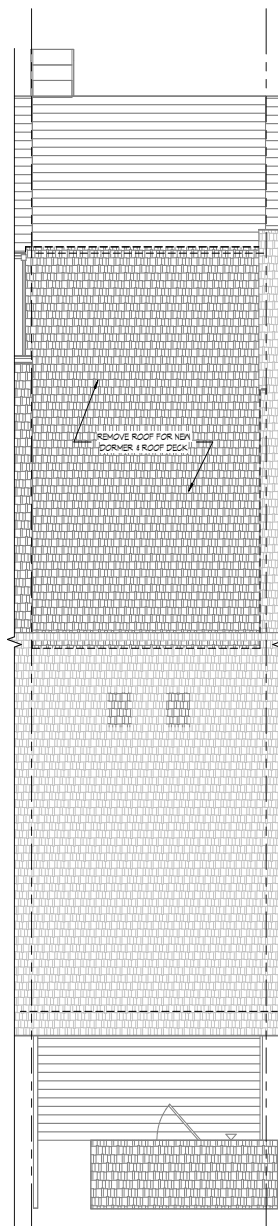

③ ROOF PLAN (EXISTING/DEMO)
1/4" = 1'-0"

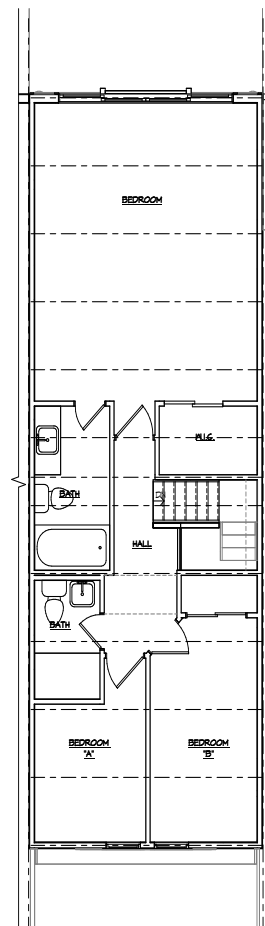

② SECOND FLOOR (EXISTING/DEMO)
1/4" = 1'-0"

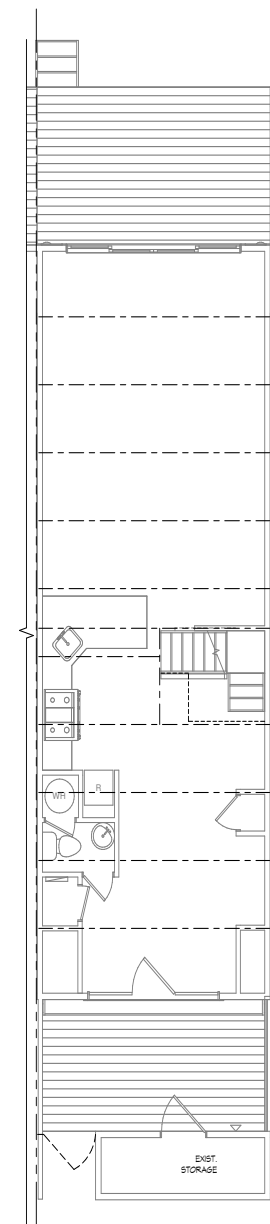

① FIRST FLOOR (EXISTING/DEMO)
1/4" = 1'-0"

PAGI / NEAL RESIDENCE ADDITION

15 SEASTRAND COURT,
DENEY BEACH, DE 19971

TAX PARCEL # 334-20.10-32.00


ELEMENT
115 W. MARKET STREET, 2nd floor
TOWNSHIP OF DENVER, DE 19971
302.645.0777
www.elemently.com

DEN	DRN	CHKD
DDN	DDN	BB
SCALE: 1/4" = 1'-0"		
JOB No.		624217
ISSUE DATE:		04.09.25


A101

DEMO PLANS


REV.	DATE	DESCRIPTION	BY

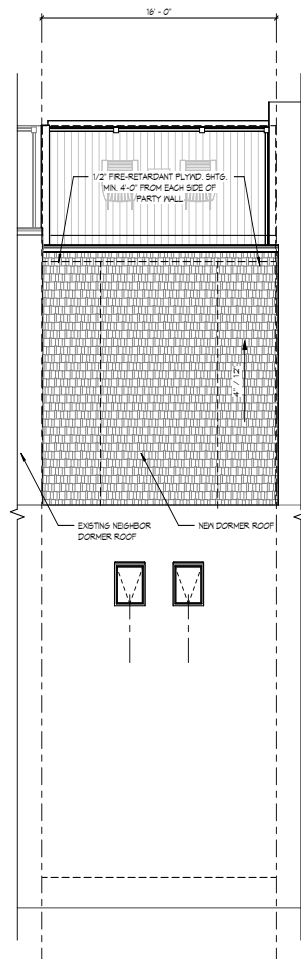


④ ROOF PLAN (PROPOSED)
1/4" = 1'-0"

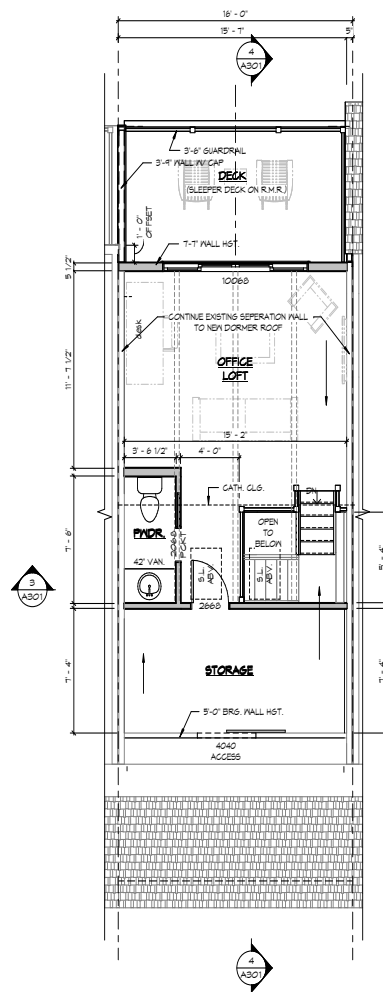


③ THIRD FLOOR (PROPOSED)
1/4" = 1'-0"

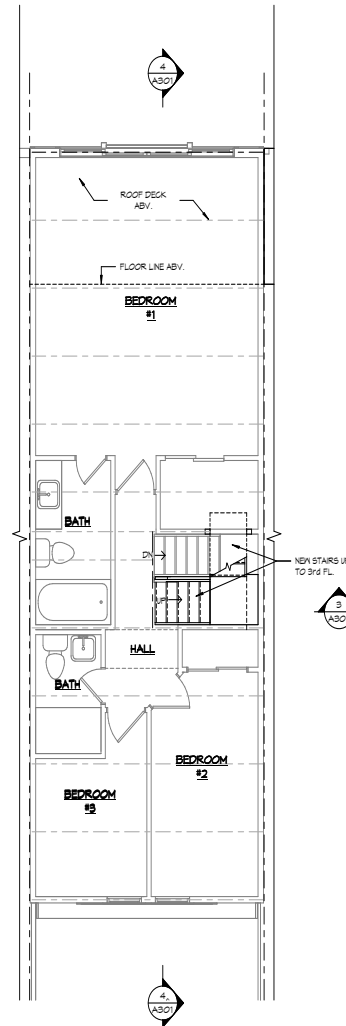


② SECOND FLOOR (PROPOSED)
1/4" = 1'-0"

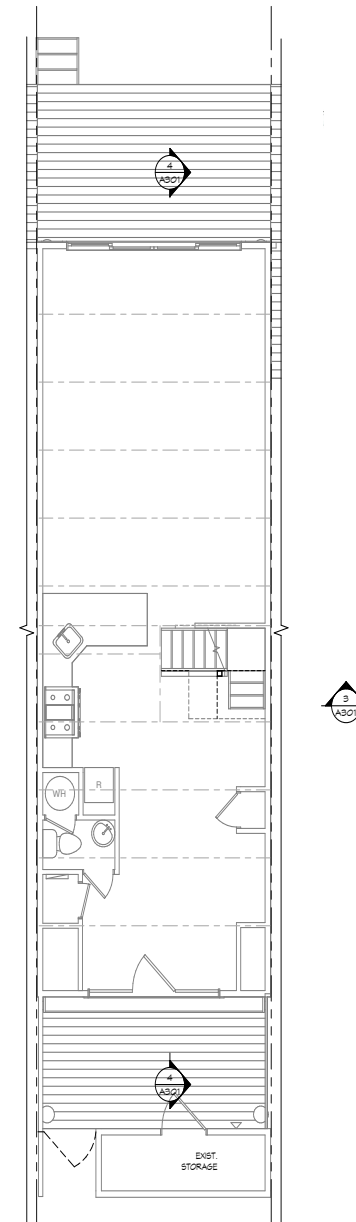


① FIRST FLOOR (PROPOSED)
1/4" = 1'-0"

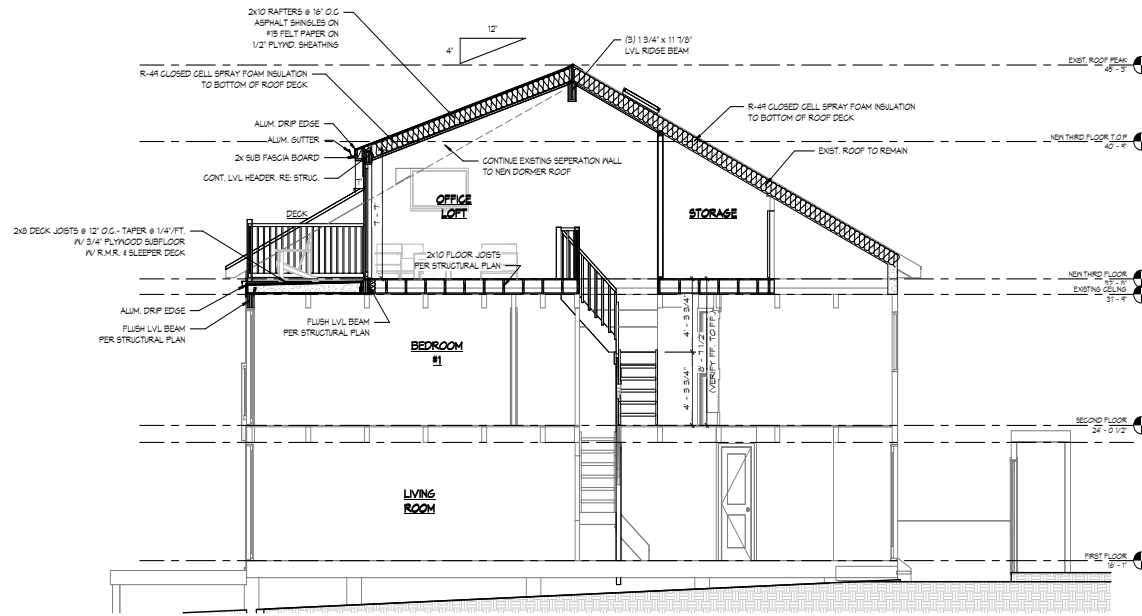


④ SECTION A
1/4" = 1'-0"

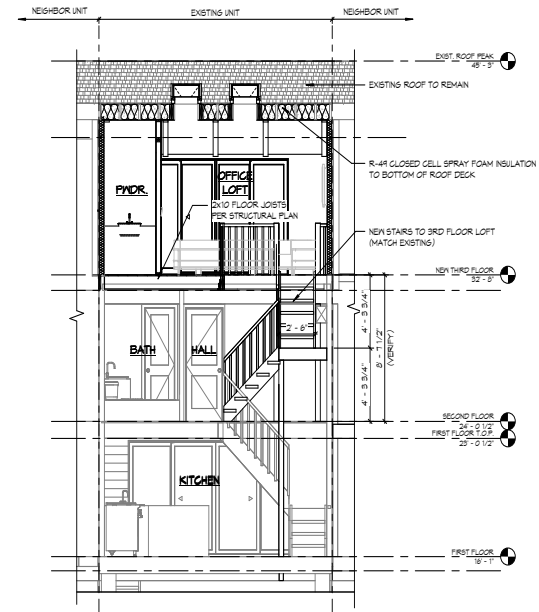


③ SECTION B
1/4" = 1'-0"

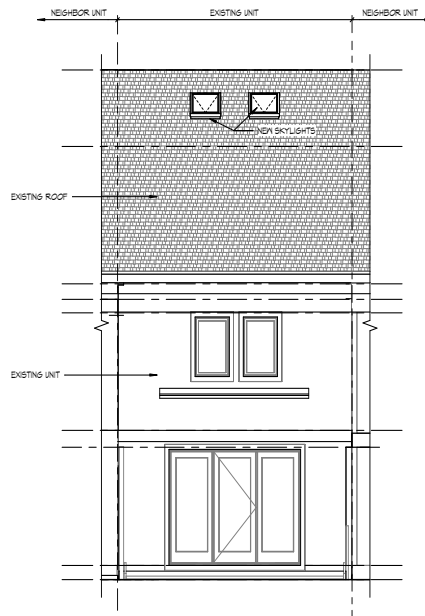

① FRONT ELEVATION (PROPOSED)
1/4" = 1'-0"

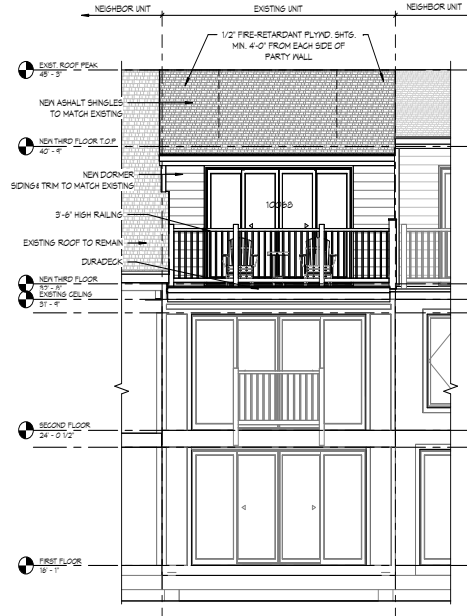

② REAR ELEVATION (PROPOSED)
1/4" = 1'-0"

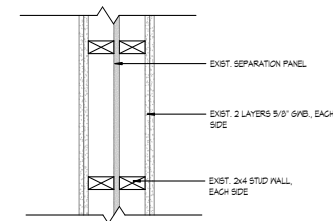

⑤ EXIST. DEMISING WALL
1 1/2" = 1'-0"

REV.	DATE	DESCRIPTION

PAGI / NEAL RESIDENCE ADDITION
15 SEASTRAND COURT,
DENEY BEACH, DE 19971
 TAX PARCEL # 334-20.10-32.00

ELEMENT
 115 W. MARKET STREET, 2ND FLOOR
 LOWES DE 19958
 302.645.0777
 www.elementny.com

DEN	DRN	CHKD
DDN	DDN	BB
SCALE: As Indicated		
JOB No. 624217		
ISSUE DATE: 04.09.25		

A301

SECTIONS & ELEVATIONS

STRUCTURAL NOTES

STRUCTURAL DESIGN CRITERIA

1. DESIGN LOADS ARE IN ACCORDANCE WITH IRC 2021, ASCE 7-16, AND THE APPLICABLE LOCAL CODES OR AS NOTED BELOW.

DEAD LOAD	
ROOF FLOOR	20 PSF
LIVE LOAD FLOOR	20 PSF
	SEE CHART

2. BUILDING OCCUPANCY CATEGORY II

3. SNOW LOADING:	
GROUND SNOW LOAD	20 PSF
FLAT-ROOF SNOW LOAD	20 PSF

4. WIND LOADING:	
BASIC WIND SPEED (3 SEC 50ST)	120 MPH
EXPOSURE CATEGORY	C

FOUNDATION

1. THE ASSUMED NET ALLOWABLE SOIL BEARING CAPACITY IS 1500 PSF UNLESS NOTED OTHERWISE. SOIL BEARING PRESSURE SHALL BE VERIFIED AT THE TIME OF EXCAVATION AND THE STRUCTURAL ENGINEER SHALL BE NOTIFIED IF THE ACTUAL BEARING PRESSURE IS LESS THAN THE DESIGN PRESSURE.

2. BOTTOM OF ALL FOOTINGS SUBJECT TO FREEZE/THAW CONDITIONS SHALL BE A MINIMUM OF TWO FEET BELOW FINISH GRADE OR TOP OF SLAB ELEVATION, WHICHEVER IS LOWER.

3. FOUNDATION DESIGN IS BASED ON REMOVAL OF ALL ORGANIC MATERIAL AND/OR MATERIAL SUBJECT TO ROT OR CORROSION. BOTTOM OF FOOTING SUBGRADE IS TO BE BEARING ON SUITABLE NATURAL SOILS AND/OR COMPACTED STRUCTURAL FILL.

4. COMPACTED STRUCTURAL FILL BENEATH ALL SLABS ON GRADE, FOUNDATIONS AND ADJACENT TO FOUNDATION WALLS SHALL BE INSPECTED AND APPROVED BY A REGISTERED GEOTECHNICAL ENGINEER PRIOR TO THE PLACEMENT OF ANY CONCRETE.

5. MAINTAIN PROPER SITE DRAINAGE DURING CONSTRUCTION TO ENSURE SURFACE RUNOFF AWAY FROM STRUCTURES AND TO PREVENT FLOODING OF SURFACE RUNOFF NEAR THE SURFACES.

6. FOUNDATION WATERPROOFING TO BE (1) COAT OF SPRAY APPLICATION (60 MILS THICK) OF TUFF-N-DRI POLYMER ENHANCED ASPHALT LIQUID APPLIED MEMBRANE OR EQUAL.

MASONRY

1. ALL MASONRY SHALL CONFORM TO ACI 530, LATEST EDITION.

2. ALL CONCRETE MASONRY UNITS SHALL BE ASTM C90, GRADE N, TYPE 1 STANDARD WEIGHT BLOCKS.

3. ALL MORTAR SHALL BE ASTM C270 TYPE M OR S WITH A MIN. COMPRESSIVE STRENGTH OF 1500 PSI AT 28 DAYS.

4. GROUT SHALL BE A HIGH SLUMP MIX IN ACCORDANCE WITH ASTM SPECIFICATION C476 HAVING A MINIMUM COMPRESSIVE STRENGTH OF 3000 PSI. GROUT CORES TO BE GROUTED AS INDICATED PER PLANS AND DETAILS.

CONCRETE

1. ALL CONCRETE WORK SHALL CONFORM TO ACI 318, MOST RECENT EDITION.

2. CONCRETE COMPRESSIVE STRENGTH AT 28 DAYS SHALL BE 3500 PSI FOR ALL FOUNDATIONS AND PIERS AND 4000 PSI FOR ALL SLABS. SLUMP AT TIME OF PLACEMENT SHALL BE MIN 3 INCHES AND MAXIMUM 5 INCHES.

3. ALL CONCRETE EXPOSED TO THE EXTERIOR SHALL BE AIR-ENTRAINED (6 ± 1%).

4. DO NOT PLACE CONCRETE AGAINST SUBGRADE CONTAINING FREE WATER, FROST, OR ICE.

5. REINFORCING BARS SHALL BE ASTM A615, GRADE 60 DEFORMED BARS. LAP ALL BARS MIN. 48 BAR DIAMETERS UNLESS NOTED OTHERWISE.

6. WELDED WIRE FABRIC SHALL BE ASTM A-105 AND/OR ASTM A497 AND MIN. GRADE 40. IT SHALL BE PROVIDED IN FLAT SHEETS AND LAPPED A MIN. OF 8 INCHES.

7. CONTROL JOINTS IN SLABS ON GRADE SHALL BE LOCATED AT MAX. 10'-0" O.C. PANELS SHALL BE AS SQUARE AS POSSIBLE. LENGTH SHOULD NOT EXCEED 15 TIMES THE WIDTH.

FRAMING NOTES

1. DESIGN LOADS: (LL) FLOOR LOAD + 40 PSF, STAIR + 40 PSF, ROOF + 20 PSF, DECK + 40 PSF.

2. ALL SAWN LUMBER MEMBERS SHALL BE K2 SPC (F_b = 875 psi), F_v = 135 psi, AND E = 1400 SAI OR BETTER.

3. ALL LVL BEAMS OR HEADERS SHALL BE GRADE 2.0E MCROLLAM LVL (F_b = 2600 psi, F_v = 295 psi, AND E = 2.0 x 10⁶ psi) OR BETTER.

4. PSB COLUMNS SHALL BE GRADE 1.0E PARALLAM PSB (F_{comp} = 545 psi, F_{comp}parallel = 2500 psi, F_v = 190, E = 1.8 x 10⁶ psi) OR BETTER.

5. PSB BEAMS SHALL BE GRADE 2.0E PARALLAM PSB (F_b = 2900 psi, F_v = 240 psi, AND E = 2.0 x 10⁶ psi) OR BETTER.

6. ALL PSB BEAMS & COLUMNS USED FOR EXTERIOR CONSTRUCTION AND EXPOSED TO THE ELEMENTS SHALL BE PARALLAM PLUS® 2 SERVICE LEVEL 2 (POLYMERIZED PSB INDICATED ON PLANS AS (N) OR APPROVED EQUAL. (COLUMNS: F_{comp} = 150 psi, F_{comp}parallel = 1500 psi, F_v = 120 psi, AND E = 1.54 x 10⁶ psi); BEAMS: F_b = 1821 psi, F_v = 191 psi, E = 1.46 x 10⁶ psi).

7. ALL EXTERIOR WALLS SHALL BE 2 x 8 STUD U.N.G. AND ALL INTERIOR WALLS SHALL BE 2 x 4 STUD U.N.G.

8. ALL NEW EXTERIOR HEADERS TO BE MIN. (3) 2 x 10 U.N.G. ALL INTERIOR HEADERS & LOAD BEARING WALLS TO BE MIN. (2) 2 x 8 U.N.G.

9. ALL HEADERS AT NON-BEARING CONDITIONS SHALL BE AS FOLLOWS:

OPENING	HEADER
UP TO 4'-0"	(2) 2 x 8
4'-0" TO 6'-0"	(2) 2 x 8
6'-0" TO 8'-0"	(2) 2 x 10

10. PROVIDE 2 x 4 FLAT BLOCKING BETWEEN JOISTS WHERE PARALLEL WALLS LIE BETWEEN.

11. PROVIDE MIN. DOUBLE FLOOR JOISTS UNDER BEARING WALLS RUNNING PARALLEL TO JOIST SYSTEM.

12. POST AND BLOCK SOLD BENEATH ALL POINT LOADS TO FOUNDATION OR SUPPORTING MEMBERS BEHIND IV MIN. (3)- 2X6 U.N.G. CROSS SECTION DIMENSIONS OF POST BELOW MUST BE EQUAL TO OR GREATER THAN POST ABOVE.

13. ALL POINT LOADS FROM STEEL, LVL, BEAMS INCLUDING RIDGE, HP & VALLEY BEAMS SHALL BE SUPPORTED BY MINIMUM (3) 2X6, (3) 2X4, OR SOLID COLUMNS AS SHOWN ON THE PLANS.

14. BALLOON FRAME ALL TWO STORY WALLS WHERE LATERAL FRAMING DOES NOT PROVIDE MID-HEIGHT BRACINGS. SOLID HORIZONTAL BLOCKING IS REQUIRED BETWEEN STUDS AT MIDPOINT OR AT THIRD POINTS FOR STUDS OVER 16'-0".

15. ALL MOOD FRAMING MATERIAL IN DIRECT CONTACT WITH MASONRY WALLS AND/OR CONCRETE FLOOR SLABS SHALL BE PRESSURE TREATED MATERIAL AND ALL FASTENERS USED SHALL BE COMPATIBLE WITH TREATMENT.

16. ALL DIMENSIONS ARE FROM TO FACE OF FRAMING AND FOUNDATION WALLS, UNLESS NOTED OTHERWISE.

17. INSTALL A CONTINUOUS ALUMINUM TERMITES SHIELD BETWEEN ANY MOOD AND CONCRETE SURFACES.



18. ENGINEERED FLOOR JOISTS ARE TO BE DESIGNED AND DETAILED BY THE MANUFACTURER. INSTALLATION AND STIFFENING IS TO BE IN ACCORDANCE WITH THE MANUFACTURER'S SPECIFICATIONS AND WRITTEN INSTRUCTIONS.

19. ALL CONSTRUCTION IN COASTAL FLOOD HAZARD ZONE AREAS TO MEET OR EXCEED THE REQUIREMENTS STATED IN FEMA TECHNICAL BULLETINS AND PER NFIP REGULATIONS.

20. PROVIDE MECHANICAL CONNECTORS AT ALL LOCATIONS WHERE THE RAFTERS ARE HANGING FROM THE RIDGE BEAM. SIMPSON LK1/L2/L3/L5/L6 HANGERS OR EQUAL, INSTALLED PER MFR. SPECIFICATIONS AND FOR THE APPROPRIATE ALLOWABLE LOADS ARE ACCEPTABLE.

LIVE LOADS (MINIMUM UNIFORMLY DISTRIBUTED IN PSF)		
USE	LIVE LOAD	REF. IRC SECTION R301.9 FOR ADDITIONAL NOTES & SPECIFICATIONS.
UNINHABITABLE ATTICS & NO STORAGE	10	A. INDIVIDUAL STAIR TREADS SHALL BE DESIGNED FOR THE UNIFORMLY DISTRIBUTED LIVE LOAD OR A 300-POUND CONCENTRATED LOAD ACTING OVER AN AREA OF 4 SQUARE INCHES, WHICHEVER PRODUCES THE GREATER STRESSES.
UNINHABITABLE ATTICS & UNLIMITED STORAGE	20	
HABITABLE ATTICS & ATTICS SERVED BY/INFINED STAIRS	30	
BALCONIES (EXT.) AND DECKS	40	
GUARDRAILS AND HANDRAILS	200	B. DESIGN LOAD: 200# AT ANY POINT IN ANY DIRECTION, UNIFORM LOAD OF 30 #/FOOT LATERALLY AT TOP OF RAIL, 100#/FOOT VERTICALLY AT TOP OF RAIL. UNIFORM LOAD IS APPLIED SIMULTANEOUSLY WITH UNIFORM LOAD.
SLEEPING ROOMS	30	
ROOMS OTHER THAN SLEEPING ROOMS	40	
STAIRS*	40	

SEE NOTE #1 REGARDING ROOF FRAMING

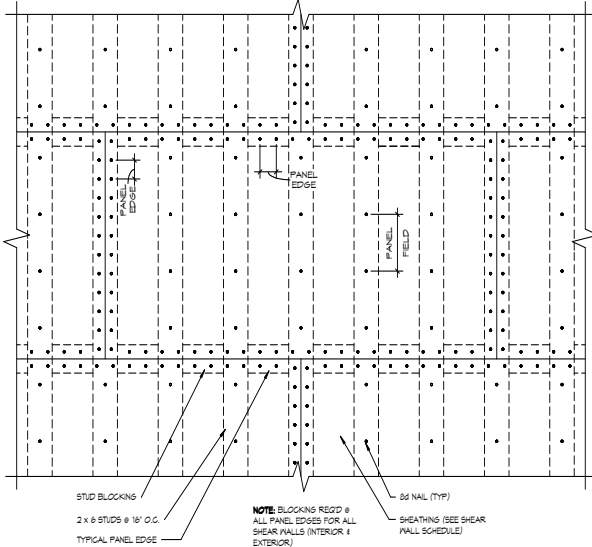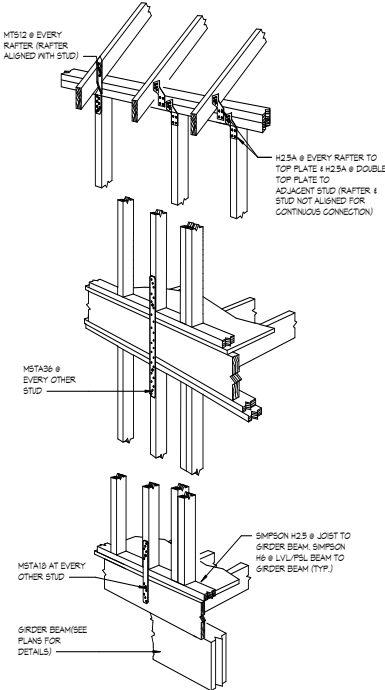

① SHEAR WALL NAILING PATTERN
3/4" x 1'-0"

NOTES:

1. ROOF FRAMING SELECT ONE OF TWO OPTIONS TO RESIST UPLIFT: A. CONNECT TRUSS/RAFTER DIRECTLY TO STUD B. CONNECT TRUSS/RAFTER TO TOP PLATE & TOP PLATE TO STUD
2. AS AN ALTERNATIVE TO THE FLOOR TO FLOOR STRAPPING ILLUSTRATED, CONTRACTOR MAY USE SHEATHING TO SPAN HORIZONTAL JOINTS. SHEATHING TO BE CONTINUOUS OVER JOINTS AND FASTENED TO FRAMING IN 3D NAILS @ 6" O.C. @ PANEL EDGES & 12" O.C. IN THE FIELD
3. BLOCK STEEL BEAMS AS REQUIRED TO INSTALL STRAPPING.

③ HURRICANE STRAPPING DETAIL
3/8" x 1'-0"

SHEAR WALL SCHEDULE		
MARK	SHEATHING	FASTENING
SW1	1/2" STRUCTURAL SHEATHING, OR 1/2" OSB EXTERIOR ONLY, BLOCKED	8D NAILS @ 6" O.C. SPACING @ PANEL EDGES & 12" O.C. IN FIELD
SW2	1/2" GYPSUM BOARD, BOTH SIDES, BLOCKED	8D COOLER NAILS @ 12" O.C. SPACING @ PANEL EDGES (INCL. TOP & BOTTOM PLATES), 12" O.C. IN FIELD

***ALL EXTERIOR WALL ON ALL FLOORS TO BE SHEAR WALL TYPE SW1 UNLESS NOTED OTHERWISE

NOTES:
1. REFERENCE SHEAR WALL NAILING PATTERN DETAIL FOR ILLUSTRATION OF PANEL EDGE AND FIELD LOCATIONS.
2. ALL SHEATHING PANEL EDGES SHALL BE NAILED DIRECTLY TO WALL STUDS AND BLOCKING.

PAGE / NEAL RESIDENCE ADDITION

15 SEASTRAND COURT,
DENEY BEACH, DE 19971


TAX PARCEL # 334-20.10-32.00

**ELEMENT**
115 W. MARKET STREET, 2nd floor
LOWES, DE 19958
302.645.0777
www.elementply.com

DWN	DRN	CHKD
-	JK	JK
SCALE: As indicated		
JOB No. 624217		
ISSUE DATE: 04.09.25		

5001


STRUCTURAL NOTES




1. MIN. (3) 2 x STUD POST AT ALL GIRDER TRUSS, STEEL & LVL BEAM BEARING LOCATIONS, U.N.O. POST/BLOCK SOLD TO FOUNDATION OR SUPPORTING MEMBER BELOW.

2. ALL EXTERIOR WALLS TO BE SHEAR WALL TYPE 'SWT', U.N.O. REFERENCE SHEAR WALL NAILING PATTERN & SCHEDULE, SHEET 5001.

DSN	DRM	CHKD
-	JK	JK
SCALE:		1/4" = 1'-0"
JOB No.		e24217
ISSUE DATE:		04.09.25
<u>5201</u>		

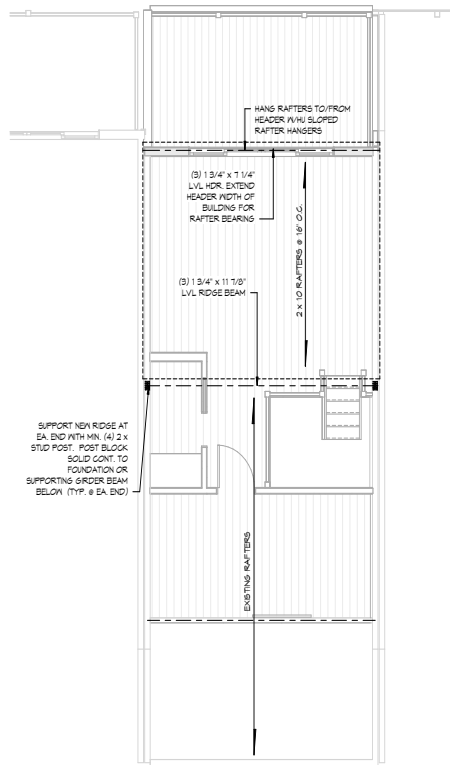

① ROOF FRAMING PLAN
1/4" = 1'-0"

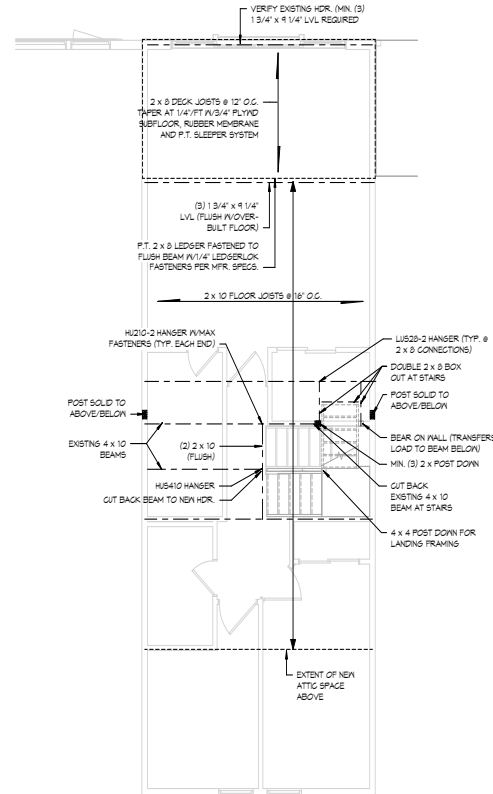

② THIRD FLOOR FRAMING PLAN
1/4" = 1'-0"

NOTES:

1. MIN. (3) 2 x 6 STUD POST AT ALL GIRDER TRUSS, STEEL, & LVL BEAM BEARING LOCATIONS, U.N.O. POST/BLOCK SOLD TO FOUNDATION OR SUPPORTING HEADER BELOW.
2. ALL EXTERIOR WALLS TO BE SHEAR WALL TYPE SMT, U.N.O. REFERENCE SHEAR WALL NAILING PATTERN & SCHEDULE, SHEET S001.

REV'S		DATE	DESCRIPTION	BY

PAGI / NEAL RESIDENCE ADDITION
15 SEASTRAND COURT,
DENEY BEACH, DE 19971
 TAX PARCEL # 334-20.10-32.00

ELEMENT
 115 W. MARKET STREET, 2nd floor
 Dover, DE 19958
 302.645.0777
 www.elementny.com

DEN	DRN	CHKD
-	JK	JK
SCALE: 1/4" = 1'-0"		
JOB No.		624217
ISSUE DATE:		04.09.25
5202		

Adjacent property owners document



Adjacent Property Owners to Seastrand Building B, Unit 15

Unit 16 – 334-20.10-31.00
Michael Davies and Nicole Anzia
5327 28th St NW
Washington, DC 20015

Unit 14 – 334-20.10-33.00
Henry J Cadell Trustee
9729 Berman Woods Way
Potomac, MD 20854